
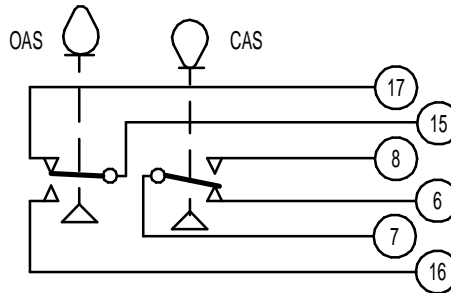
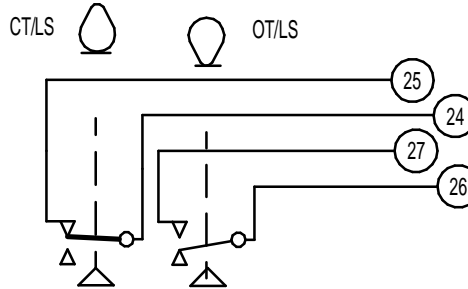


CIRCUIT IS DRAWN FOR A VALVE IN THE FULLY CLOSED POSITION

CIRCUIT IS DRAWN FOR A VALVE IN THE FULLY CLOSED POSITION

Circuit Diagram No - Issue No

**5S00Q00A - 1**

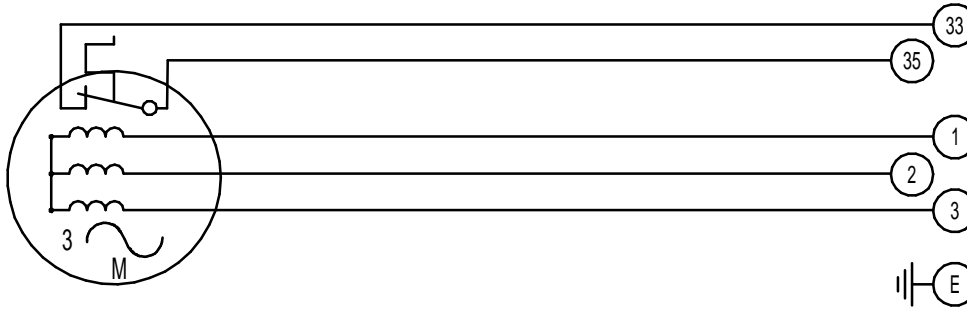

THERMOSTAT

3 PHASE SUPPLY

OT/LS - OPEN TORQUE/LIMIT SWITCH.  
 CT/LS - CLOSE TORQUE/LIMIT SWITCH.  
 OAS - OPEN AUXILIARY SWITCH.  
 CAS - CLOSE AUXILIARY SWITCH.

WIRES ARE IDENTIFIED AT EACH END BY  
 TERMINAL NUMBER OR NUMBER SHOWN.  
 ALLOW MINIMUM 2 SECOND DELAY  
 WHEN CONTROL SIGNALS ARE REVERSED  
 TO ENSURE MOTOR REVERSAL.

**WARNING**  
 IT IS ESSENTIAL THAT REMOTE  
 CONTROL CIRCUITS ARE DESIGNED  
 SO THAT AN OPEN AND A CLOSE  
 SIGNAL CAN NEVER BE APPLIED  
 SIMULTANEOUSLY.

| Iss | Date   | Chkd | Revision Details       |
|-----|--------|------|------------------------|
| 01  | 180118 | JS   | FIRST PRODUCTION ISSUE |

**centork**

ROTORK CONTROLS (INDIA) PRIVATE LTD  
 28B, AMBATTUR INDUSTRIAL ESTATE (NORTH),  
 AMBATTUR, CHENNAI - 600 098 INDIA.  
 Tel:044-39555600

Q - 3 PHASE STANDARD

Drawn by: K.S  
 Date : 020490  
 Base WD: 2S00Q00  
 Job No : ---  
 MI No : .

Circuit Diagram No  
**5S00Q00A**  
 Issue No  
**1**