


CIRCUIT IS DRAWN FOR A VALVE IN THE FULLY CLOSED POSITION

Circuit Diagram No - Issue No
1P02Q60 - 04



TRANSFORMER VOLTAGE SELECTION

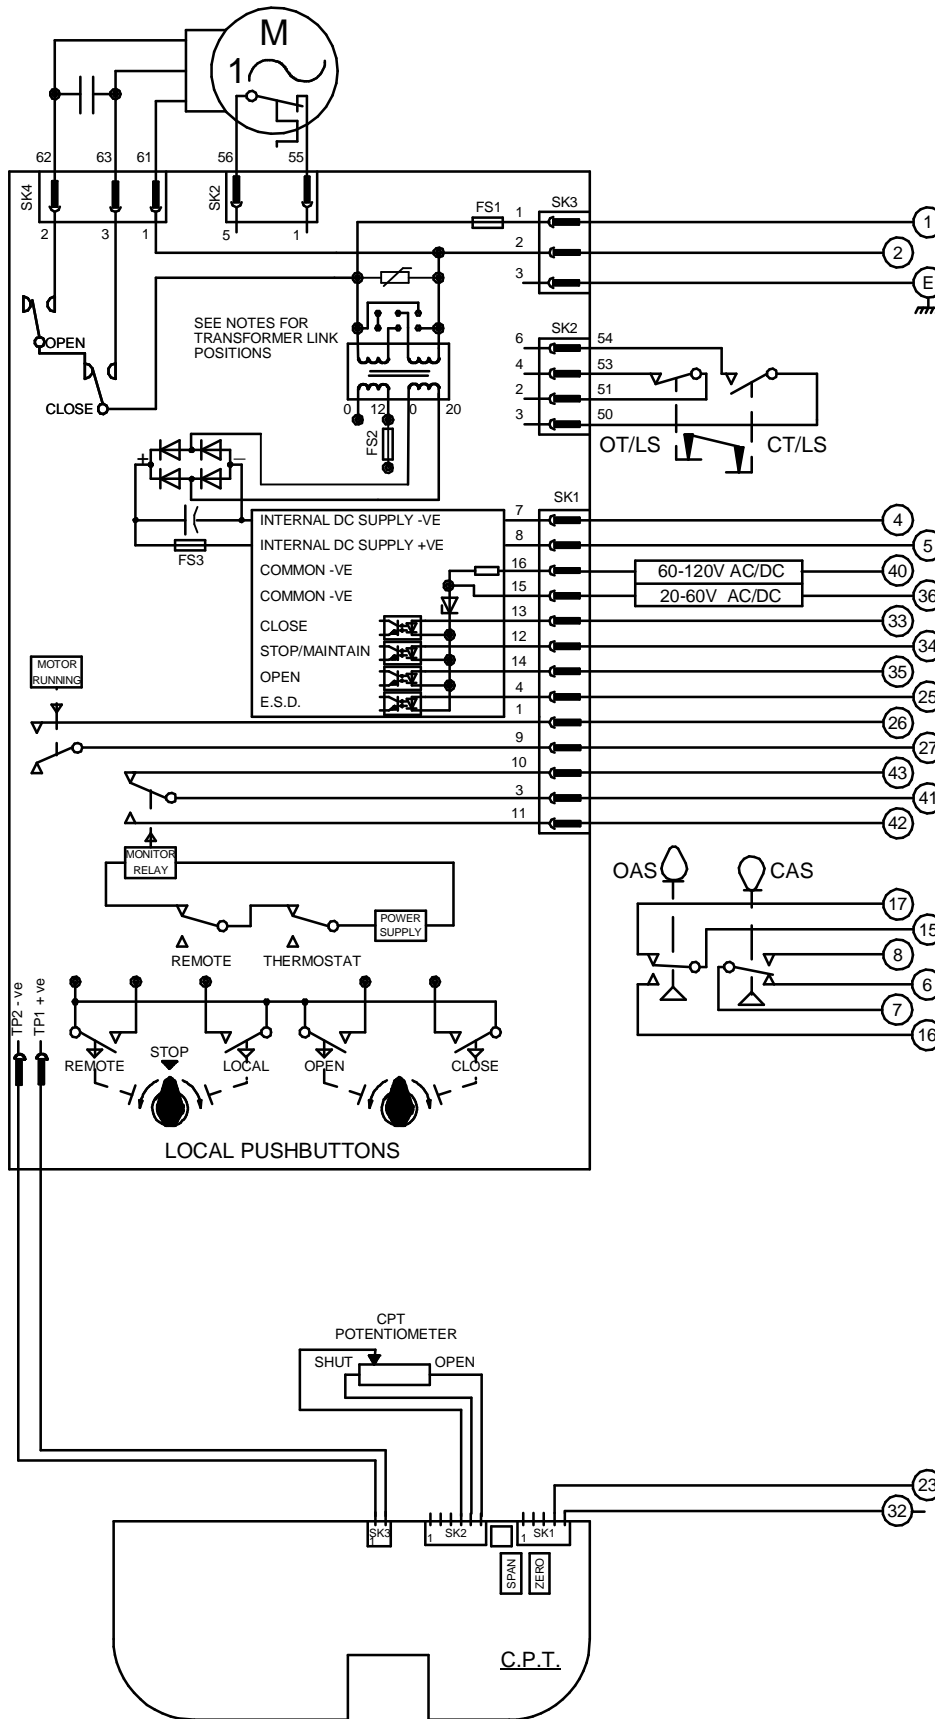

SET SWITCH AS ABOVE FOR
 198V - 264V SUPPLIES



SET SWITCH AS ABOVE FOR
 99V - 132V SUPPLIES

- OT/LS - OPEN TORQUE/LIMIT SWITCH.
- CT/LS - CLOSE TORQUE/LIMIT SWITCH.
- OAS - OPEN AUXILIARY SWITCH.
- CAS - CLOSE AUXILIARY SWITCH.

WIRES ARE IDENTIFIED AT EACH END BY
 TERMINAL NUMBER OR NUMBER SHOWN.

- FS1 - 6.3A
- FS2 - 250mA
- FS3 - 160mA

TERMINALS 4 & 5 FUSED
 INTERNALLY AT 160mA

E.S.D. CONTROL SIGNAL VOLTAGE MUST
 BE EQUAL TO OR GREATER THAN ALL
 OTHER CONTROL SIGNAL VOLTAGES.

Iss	Date	Chkd	Revision Details
03	230590	PGS	SIMILAR TO 1P02Q60 JOB NO --- SK1 & SK4 PIN NOS CORRECTED. CHECKED K.S.
04	270417	JS	FUSE RATING & TRANSFORMER VOLTAGE SELECTION CHANGED AS PER NEW PCB ECN / 7023

centork

ROTORK CONTROLS (INDIA) PRIVATE LTD
 28B, AMBATTUR INDUSTRIAL ESTATE (NORTH),
 AMBATTUR, CHENNAI - 600 098 INDIA.
 Tel:044-39555600

Q-PAK + POTENTIOMETER. + C.P.T.

Drawn by: P.W.
 Date : 230590
 Base WD: 1P02Q60
 Job No : --
 MI No : .

Circuit Diagram No
1P02Q60
 Issue No
4