

CIRCUIT IS DRAWN FOR A VALVE IN THE FULLY CLOSED POSITION


Circuit Diagram No - Issue No

2P06Q30 - 02

CIRCUIT IS DRAWN FOR A VALVE IN THE FULLY CLOSED POSITION

WARNING

IT IS ESSENTIAL THAT REMOTE CONTROL CIRCUITS ARE DESIGNED SO THAT AN OPEN AND A CLOSE SIGNAL CAN NEVER BE APPLIED SIMULTANEOUSLY.

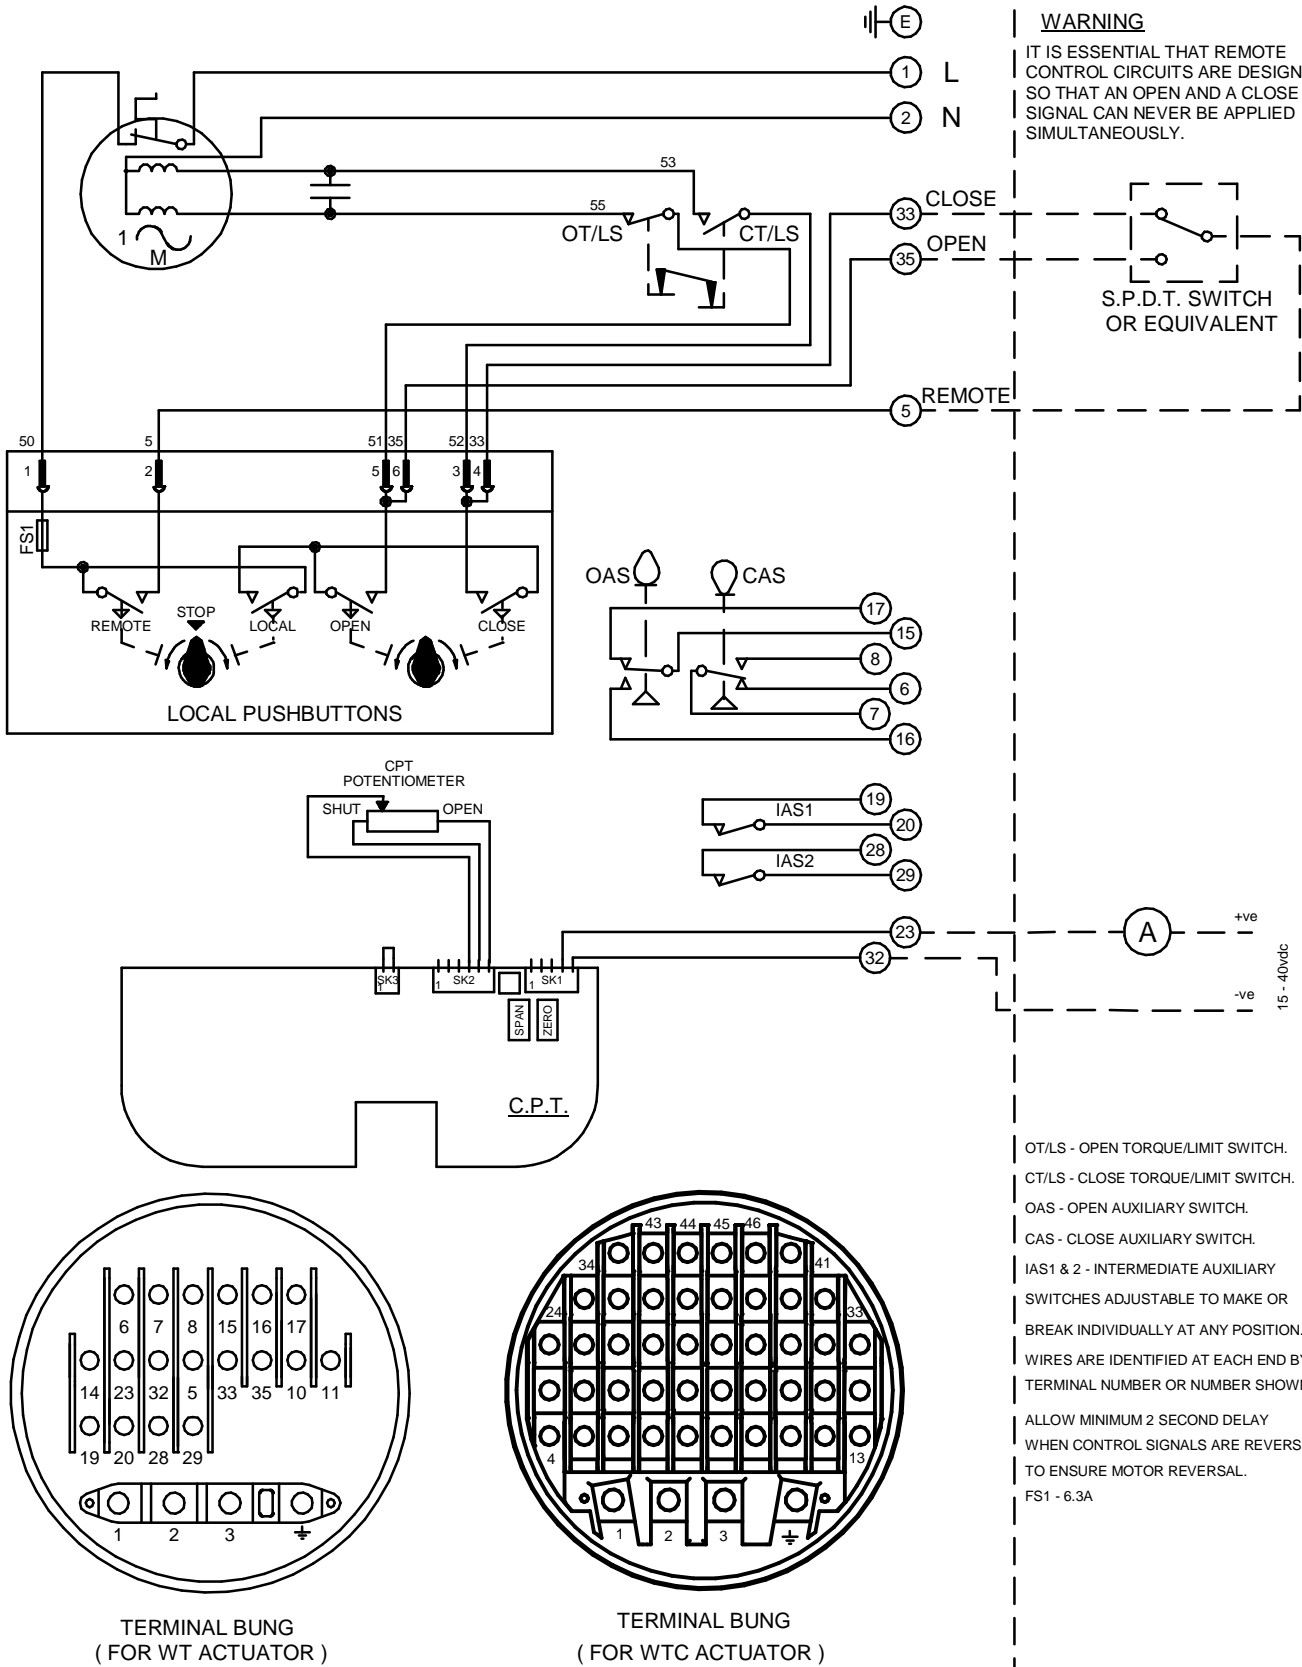

S.P.D.T. SWITCH OR EQUIVALENT

A +ve
-ve
15 - 40Vdc

TERMINAL BUNG (FOR WT ACTUATOR)

TERMINAL BUNG (FOR WTC ACTUATOR)

Iss 01	Date	Chkd PGS	Revision Details SIMILAR TO 2P06Q30 JOB NO ----	centork	Q - STANDARD + PUSHBUTTONS + 2 INTERMEDIATE SW & CPT.
02	260417	JS	PAK TERMINAL BUNG INTRODUCED FOR WTC APPLICATION EC7024.		
ROTORK CONTROLS (INDIA) PRIVATE LTD 28B, AMBATTUR INDUSTRIAL ESTATE (NORTH), AMBATTUR, CHENNAI - 600 098 INDIA. Tel:044-39555600				Drawn by: K.S Date : 131292 Base WD: 2P06Q30 Job No : --- MI No : ..	Circuit Diagram No 2P06Q30 Issue No 2