


CIRCUIT IS DRAWN FOR A VALVE IN THE FULLY CLOSED POSITION

Circuit Diagram No - Issue No

1P02Q00A - 03

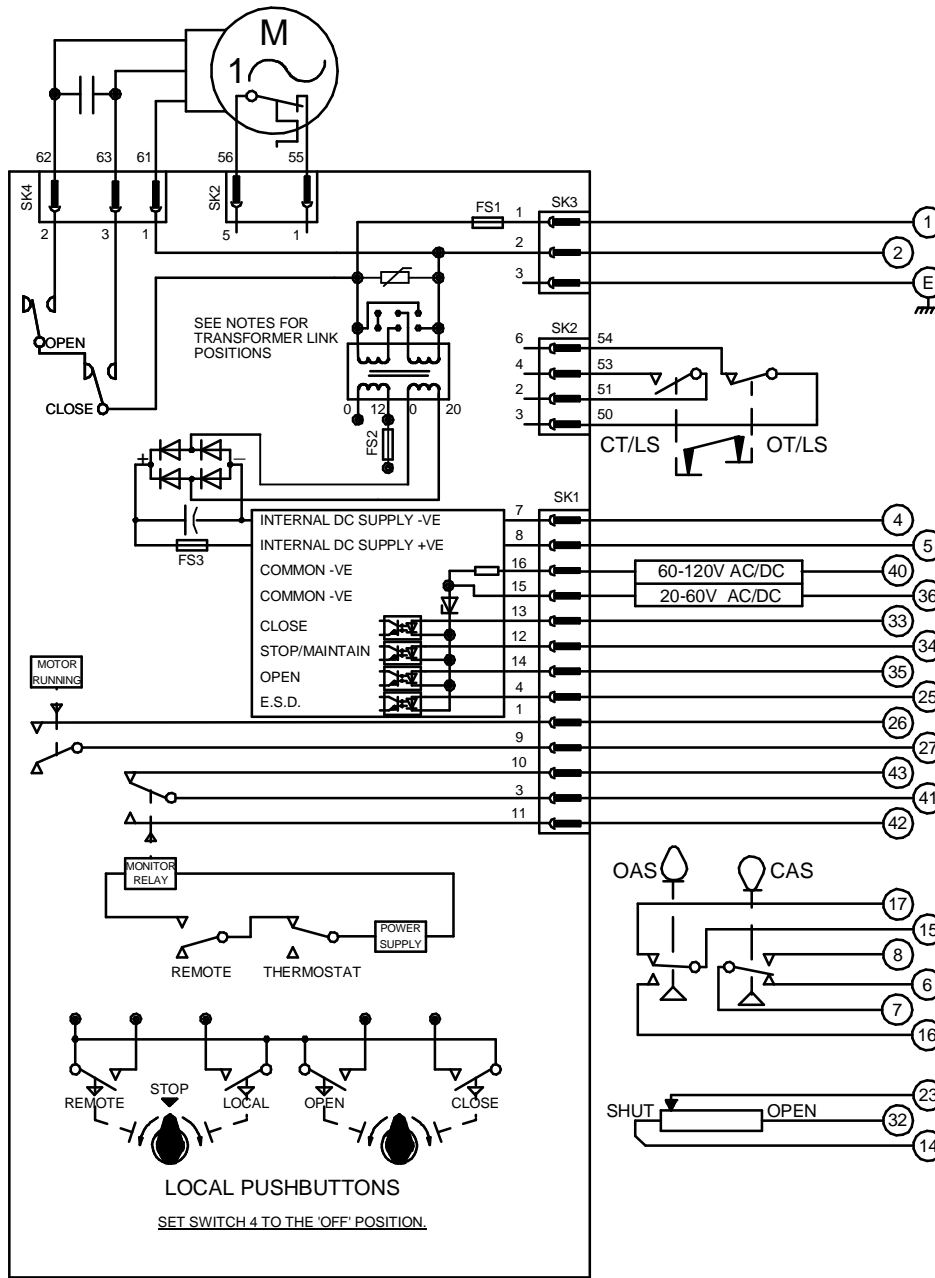

TRANSFORMER VOLTAGE SELECTION



SET SWITCH AS ABOVE FOR
198V - 264V SUPPLIES



SET SWITCH AS ABOVE FOR
99V - 132V SUPPLIES

- OT/LS - OPEN TORQUE/LIMIT SWITCH.
- CT/LS - CLOSE TORQUE/LIMIT SWITCH.
- OAS - OPEN AUXILIARY SWITCH.
- CAS - CLOSE AUXILIARY SWITCH.

WIRES ARE IDENTIFIED AT EACH END BY
TERMINAL NUMBER OR NUMBER SHOWN.

- FS1 - 6.3A
- FS2 - 250mA
- FS3 - 160mA

TERMINALS 4 & 5 FUSED
INTERNALLY AT 160mA

E.S.D. CONTROL SIGNAL VOLTAGE MUST
BE EQUAL TO OR GREATER THAN ALL
OTHER CONTROL SIGNAL VOLTAGES.

Iss	Date	Chkd	Revision Details
02	230590	PGS	SIMILAR TO 1P02Q00A JOB NO --- SK1 & SK4 PIN NOS CORRECTED. CHECKED K.S.
03	270417	JS	FUSE RATING & TRANSFORMER VOLTAGE SELECTION CHANGED AS PER NEW PCB ECN / 7023

centork

ROTORK CONTROLS (INDIA) PRIVATE LTD
28B, AMBATTUR INDUSTRIAL ESTATE (NORTH),
AMBATTUR, CHENNAI - 600 098 INDIA.
Tel:044-39555600

Q-PAK + POTENTIOMETER. -

Drawn by: K.S
Date : 040490
Base WD: 1P02Q00A
Job No : --
MI No : .

Circuit Diagram No
1P02Q00A
Issue No
3