


CIRCUIT IS DRAWN FOR A VALVE IN THE FULLY CLOSED POSITION

CIRCUIT IS DRAWN FOR A VALVE IN THE FULLY CLOSED POSITION

Circuit Diagram No - Issue No

5S02Q30 - 1

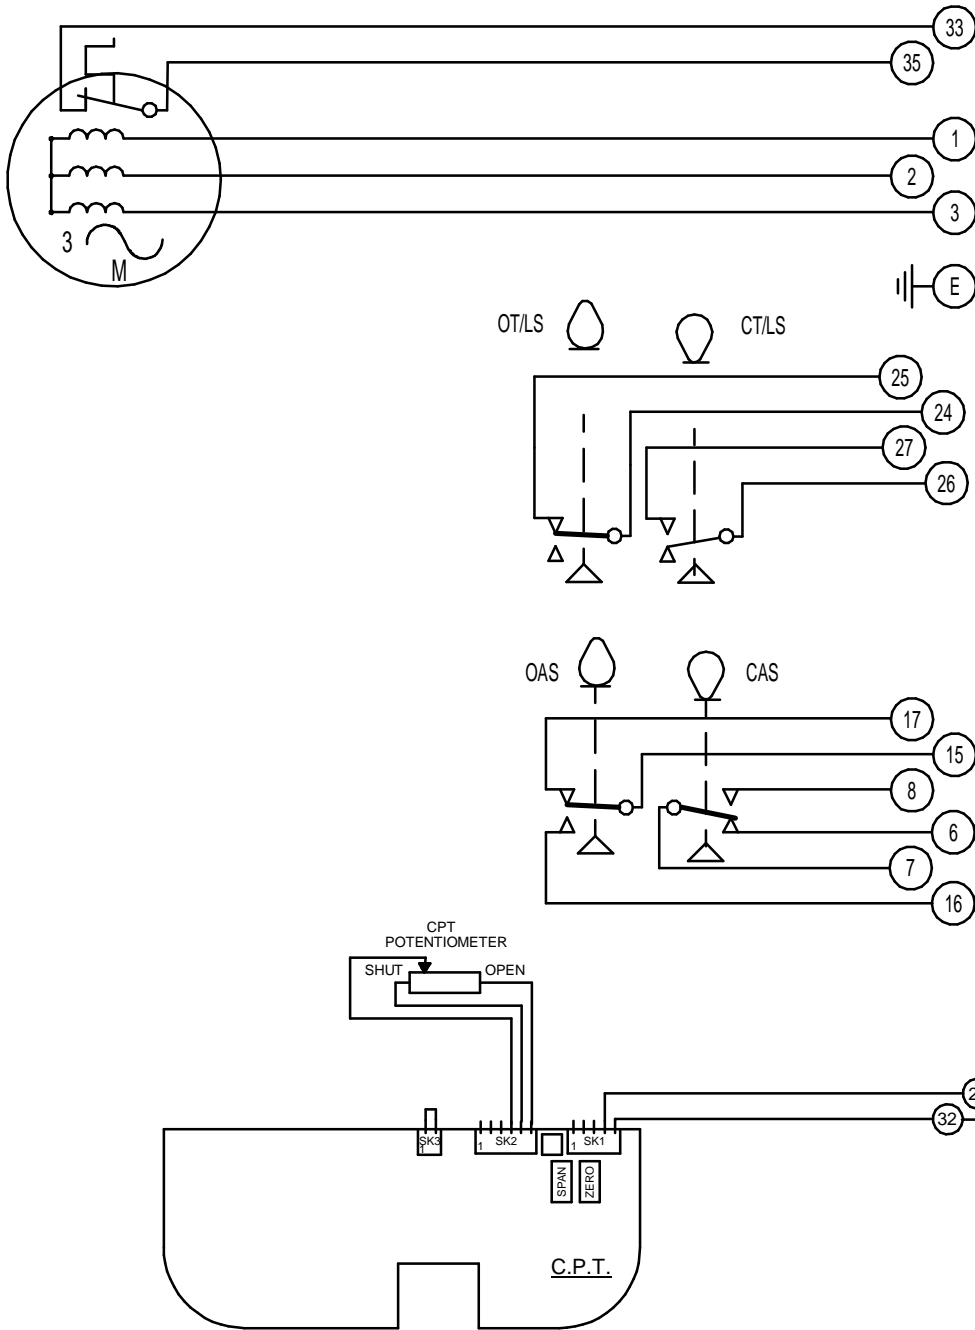

THERMOSTAT

3 PHASE SUPPLY

OT/LS - OPEN TORQUE/LIMIT SWITCH.  
 CT/LS - CLOSE TORQUE/LIMIT SWITCH.  
 OAS - OPEN AUXILIARY SWITCH.  
 CAS - CLOSE AUXILIARY SWITCH.

WIRES ARE IDENTIFIED AT EACH END BY  
 TERMINAL NUMBER OR NUMBER SHOWN.  
 ALLOW MINIMUM 2 SECOND DELAY  
 WHEN CONTROL SIGNALS ARE REVERSED  
 TO ENSURE MOTOR REVERSAL.

**WARNING**

IT IS ESSENTIAL THAT REMOTE  
 CONTROL CIRCUITS ARE DESIGNED  
 SO THAT AN OPEN AND A CLOSE  
 SIGNAL CAN NEVER BE APPLIED  
 SIMULTANEOUSLY.

Iss	Date	Chkd	Revision Details
01	050218	JS	FIRST PRODUCTION ISSUE

**centork**  
 ROTORK CONTROLS (INDIA) PRIVATE LTD  
 28B, AMBATTUR INDUSTRIAL ESTATE (NORTH),  
 AMBATTUR, CHENNAI - 600 098 INDIA.  
 Tel:044-39555600

Q - 3 PHASE STANDARD + POT &  
 EXTERNAL POWER CPT

Drawn by: JS Date : 150218 Base WD: 5S00Q00 Job No : --- MI No : .	Circuit Diagram No <b>5S02Q30</b>	Issue No <b>1</b>
--	--------------------------------------	----------------------